

AIRBORNE SOUND ATTENUATION BETWEEN ROOMS SHARING A COMMON CEILING PLENUM

Shadex – Plaster Acoustic Tile – Tegular Edge

Report No. ALA 16-091-2

Tested to ASTM E1414/E1414M – 11A

26th April 2016



For

AUSTRALIAN PLASTER ACOUSTICS

**83 – 85 Boundary Road
MORTDALE NSW 2223**

CONTENTS

Page

| | | |
|----|---|---|
| 1. | TEST OBJECTIVE | 3 |
| 2. | DESCRIPTION | |
| | 2.1 Test Sample | 3 |
| | 2.2 Installation of Sample | 3 |
| 3. | TEST FACILITIES | |
| | 3.1 Size of Test Rooms | 3 |
| | 3.2 Dividing Wall | 4 |
| | 3.3 Plenum | 4 |
| | 3.4 Acoustic Diffusion | 4 |
| | 3.5 Temperature / Humidity | 4 |
| 4. | TEST PROCEDURE | |
| | 4.1 Sound Source | 4 |
| | 4.2 Microphone Positions | 5 |
| | 4.3 Reverberation Time Measurements | 5 |
| | 4.4 Test Equipment | 5 |
| 5. | Results | |
| | 5.1 Results | 5 |
| | 5.2 Equivalent Sound Absorption Area | 5 |
| | 5.3 Significance | 6 |
| | Airborne Sound Attenuation between Rooms – Data Sheet | 7 |

| Report Version | Author | Date |
|----------------|------------------|-----------------|
| Initial | Norbert Gabriels | 26th April 2016 |

The report tester and author is a Fellow of the Australian Acoustical Society.

Disclaimer – The information contain within this report is solely for the use of the client identified on the cover page. The results reported above apply to the specific specimen as tested. No responsibility is assumed for performance of any other specimen.

The report is based on a specific scope as agreed between Acoustic Laboratories Australia Pty Ltd and the client. Acoustic Laboratories Australia Pty Ltd accepts no liability where this report is used by any third party who may rely upon this document. No section of this report can be used by a third-party without prior approval from the client and Acoustic Laboratories Australia Pty Ltd. This report must not be reproduced or reviewed, except in full.

1. TEST OBJECTIVE

Australian Plaster Acoustics commissioned Acoustic Laboratories Australia to measure the room-to-room airborne sound insulation of the 'Shadex' plaster acoustic ceiling tile with tegular edge with a plenum above ceiling. The test was carried out on April 13, 2016.

The tests were carried out at the Heafod Laboratory facility in Bayswater, Western Australia. The ceiling sample under test was installed in an exposed Tee Bar ceiling suspension system with a plenum above a dividing wall that separates the two rooms of the test facility. The laboratory space is arranged so that it simulates a pair of horizontally adjacent rooms sharing a common suspended ceiling system, plenum and dividing wall. The dividing wall extends to the underside of the ceiling system which is continuous over the two rooms.

The test was carried out in general accordance with ASTM E1414/E1414M-11a - Standard Test Method for *Airborne Sound Attenuation Between Rooms Sharing a Common Ceiling Plenum*.

2. DESCRIPTION

2.1 Test Sample

The plaster acoustic tile sample under test as described by the manufacturer consists of:

- Australian Plaster Acoustics 'Shadex' 600 x 600 mm plaster acoustic ceiling tile with Tegular edges on all sides
- Nominal 15% open area
- 25mm glasswool insulation at 32 kg/m³ backing within each tile compressed to 20mm thickness
- Thin (2mm) plaster skim coat over insulation to seal the tile
- Overall thickness of tile is 28mm
- Nominal weight 4.5 kg / tile

2.2 Installation of the Sample:

The tile was installed within a 600 x 600mm exposed Aluminium Tee bar grid.

The tee bar was suspended on 20 hangers connected to a secondary support system of 5 tee bars suspended 220 mm from the soffit of the slab. Ceiling grid was suspended off this secondary grid. The overall ceiling plenum depth is 740mm.

The ceiling was continuous over the 75mm by 50mm partition capping. Two strips of Raven RP 48 soft EPDM "D" seal were adhered to the partition capping to provide a seal to the plaster acoustic tile continuous over the capping.

A Tee bar was located on the partition capping. A 6mm timber spacer was located under the Tee bar to permit the testing of tegular edge tiles.

3. TEST FACILITIES

3.1 Size of test Rooms

The test facility consists of a parallelepiped room 9.0m long, 4.9m wide and 3.6m high. A barrier from floor to underside of ceiling divides the space unequally into two areas 4m and 4.5 metres long. The rooms are constructed of reinforced concrete with a vibration break in the walls, floor and roof in the line of the barrier. The volumes of the two rooms below the ceiling are 68m³ and 55m³.

3.2 Separating Wall

The dividing barrier is constructed as a dual stud, insulated plasterboard partition wall with 3 layers 13mm fire rated plasterboard each side of the partition. The wall is 4.9 metres wide and tapered at its upper extremity. The cap on top of the wall is 75mm x 50mm.

3.3 Plenum

3.3.1 *Plenum Height:* The plenum height is 740mm.

3.3.2 *Plenum Width:* The plenum width at the separating wall was set at 4.3 metres. The restriction in the plenum width was achieved by installing 16mm fire-rated plasterboard barriers on either side of the plenum. Plenum barriers extended from the top of ceiling tile to underside of slab over.

3.3.3 *Plenum Lining:* All sides of the plenum are lined with perforated foil faced 75mm 32Kg/m³ density fibreglass insulation with sound absorption coefficients meeting requirements of ASTM 1414 clause 7.1.5.1

3.4 Acoustic Diffusion

Sound diffusion is achieved in each room by 6 off 1.2m square 19mm structural ply panels randomly oriented and suspended on two poles within the room. 8.64m² of one sided acoustic diffusion is provided in each room.

3.5 Temperature / Humidity

The temperature and relative humidity conditions at commencement of test were:

| Acoustic Chamber 2 | | Acoustic Chamber 3 | |
|--------------------|---------------|--------------------|---------------|
| Temperature. | Rel. Humidity | Temperature. | Rel. Humidity |
| 19 °C | 70 % | 19 °C | 67% |

4. TEST PROCEDURE

The test procedure involves a sound source fed to loudspeakers in the source room being measured in both the Source and Receiver rooms, and the measurement of Reverberation Times in the Receiver room. The measurement is carried out in both directions with loudspeakers installed in each room during the entire test. The normalised ceiling attenuation is measured separately for each direction of test; the value reported is the arithmetic average of the two results.

4.1 Sound Source

Two wide band random noise generators were connected via a 2 channel amplifier to two loudspeakers. The loud speakers were positioned in the trihedral corners of the room opposite the barrier wall.

The noise level of the source was adjusted so that the sound levels in the receiving room were at least 10 dB above the Background noise level in all relevant frequency bands.

4.2 Microphone Positions

A single microphone was used for the measurement in both the source and receiver rooms. A total of 8 microphone positions were used in both the source and receiving room.

4.3 Reverberation Time Measurements

The Reverberation Time in the two receiving rooms was measured using two source positions and 4 microphone positions, providing 8 independent source / microphone positions in each room. The Reverberation Time was evaluated over a 30 dB range.

The 6 decays at each measurement position were first ensemble averaged, and then the results at each of the 8 measurement positions in each room were then arithmetically averaged, equating to a total of 48 decays in each room

4.4 Test Equipment

- Neutrik Minirator MR1 – Professional sound source.
- Yamaha P3200 Stereo Amplifier Type 3600 – 400 watt / channel
- Behringer Eurorack MX602A Serial D002205486
- B&K Analyser Type 2270 Serial No 2644641 – (Cal: 10/4/14)
- B&K Microphone Type 4189 Serial No 2643586 (Cal: 11/04/14)
- Rion NC73 Sound Level Calibrator Serial No 1030728 – (Cal: 17/09/14)
- Lorantz Speakers
- Vaisla HM34C Humidity & Temperature Meter Serial No: V2910014

5. RESULTS

5.1 Results

5.1.1 Ceiling Attenuation Class

The airborne sound attenuation between rooms of the Test Sample was tested at each one third octave band with centre frequencies between 100 and 5000 Hertz. The results of the measurements in 1/3 octave bands are given in the attached Data Sheet. The Ceiling Attenuation Class was determined at **CAC 32**

The Ceiling Attenuation Class CAC was determined in accordance with ASTM E413 *Classification for Rating of Sound Insulation*

5.1.2 Normalised Ceiling Attenuation $D_{n,c}$

The normalised ceiling attenuation between rooms as determined in octave bands is set out below

| Normalised Ceiling Attenuation in Octave Bands | | | | | | |
|--|-----|-----|-----|----|----|----|
| Frequency (Hz) | 125 | 250 | 500 | 1k | 2k | 4k |
| Sound Reduction (R) in dB | 14 | 22 | 32 | 41 | 32 | 35 |
| | | | | | | |

5.2 Equivalent Sound Absorption Area

The equivalent absorption area in each of the rooms was determined from the measured Reverberation Time in accordance with AS/ISO 354.

The Equivalent Absorption Area and the Normalised Ceiling Attenuation $D_{n,c}$ of the specimen at each one third octave band with centre frequencies between 100 and 4,000 Hertz is given in the Table 1.

| Centre Frequency Hz | Room AC2 Equivalent Absorption Area A in m2 | Room AC3 Equivalent Absorption Area A in m2 | Normalised Ceiling Attenuation $D_{n,c}$ dB |
|------------------------|---|---|---|
| 100 | 15.3 | 9.4 | 13.2 |
| 125 | 16.1 | 11.7 | 13.7 |
| 160 | 12.5 | 9.7 | 17.2 |
| 200 | 11.4 | 7.8 | 20.6 |
| 250 | 11.9 | 9.3 | 23.3 |
| 315 | 12.4 | 9.0 | 23.3 |
| 400 | 14.1 | 11.6 | 29.0 |
| 500 | 13.5 | 10.5 | 33.0 |
| 630 | 12.7 | 10.6 | 37.0 |
| 800 | 12.8 | 10.5 | 41.9 |
| 1k | 12.8 | 10.9 | 43.4 |
| 1.25k | 12.1 | 10.9 | 39.8 |
| 1.6k | 11.3 | 10.1 | 33.4 |
| 2k | 10.5 | 9.1 | 31.9 |
| 2.5k | 9.6 | 8.7 | 32.1 |
| 3.15k | 9.9 | 8.6 | 33.2 |
| 4k | 9.2 | 8.4 | 33.8 |

TABLE 1. Equivalent Absorption Area in each of the test chambers, and Normalised Ceiling Attenuation of Sample

5.3 Significance

The data in this report was obtained in a laboratory environment specified in ASTM E1414. According to ASTM E1414-11A Section 5, this environment does not include many elements typical in the real world environments which may substantially alter the performance of a system by providing alternate paths for the sound to be transmitted between rooms. However, this type of test method has been successfully used for a number of years to compare ceiling systems.

Test & Report by:


Norbert Gabriels B.Arch F.A.A.S.



Checked by:

Kingsley Hearne B.Arch M.A.A.S.





AIRBORNE SOUND ATTENUATION BETWEEN ROOMS SHARING COMMON CEILING PLENUM

Unit 3/2 Hardy Street
South Perth 6151
Tel: 9474 4477
Fax: 9474 5977

ALA Test No.: 16-091-2
Client: Australian Plaster Acoustics
Specimen: Shadex tegular edge
Detail: 600 x 600 Plaster Acoustic Tile

Description of Specimen:

Shadex Tile, Tegular Edge 600 x 600 28mm thick Plaster Acoustic Tile
Nominal open area 15%
25mm glasswool insulation @ 32 kg/m³; compressed to 20mm
Thin 2mm plaster skim coat over insulation to seal tile
Weight per tile 4.5 Kg
Lay in Tee Bar grid


Meas. Date: 13-Apr-16

Tested in accordance with
ASTM E1414 / E1414M - 11a

CEILING ATTENUATION CLASS

CAC 32

| Centre Frequency | Dnc | CAC Curve | Deficiencies |
|------------------|-----------|-----------|--------------|
| Hz | dB | dB | dB |
| 100 | 13.2 | | |
| 125 | 13.7 | 16 | 2.3 |
| 160 | 17.2 | 19 | 1.8 |
| 200 | 20.6 | 22 | 1.4 |
| 250 | 22.6 | 25 | 2.4 |
| 315 | 23.3 | 28 | 4.7 |
| 400 | 29.0 | 31 | 2.0 |
| 500 | 33.0 | 32 | |
| 630 | 37.0 | 33 | |
| 800 | 41.9 | 34 | |
| 1k | 43.4 | 35 | |
| 1.25k | 39.8 | 36 | |
| 1.6k | 33.4 | 36 | 2.6 |
| 2k | 31.9 | 36 | 4.1 |
| 2.5k | 32.1 | 36 | 3.9 |
| 3.15k | 33.2 | 36 | 2.8 |
| 4k | 33.8 | 36 | 2.2 |
| 5k | 38.9 | | |
| Total | | | |
| CAC | 32 | | 30.2 |

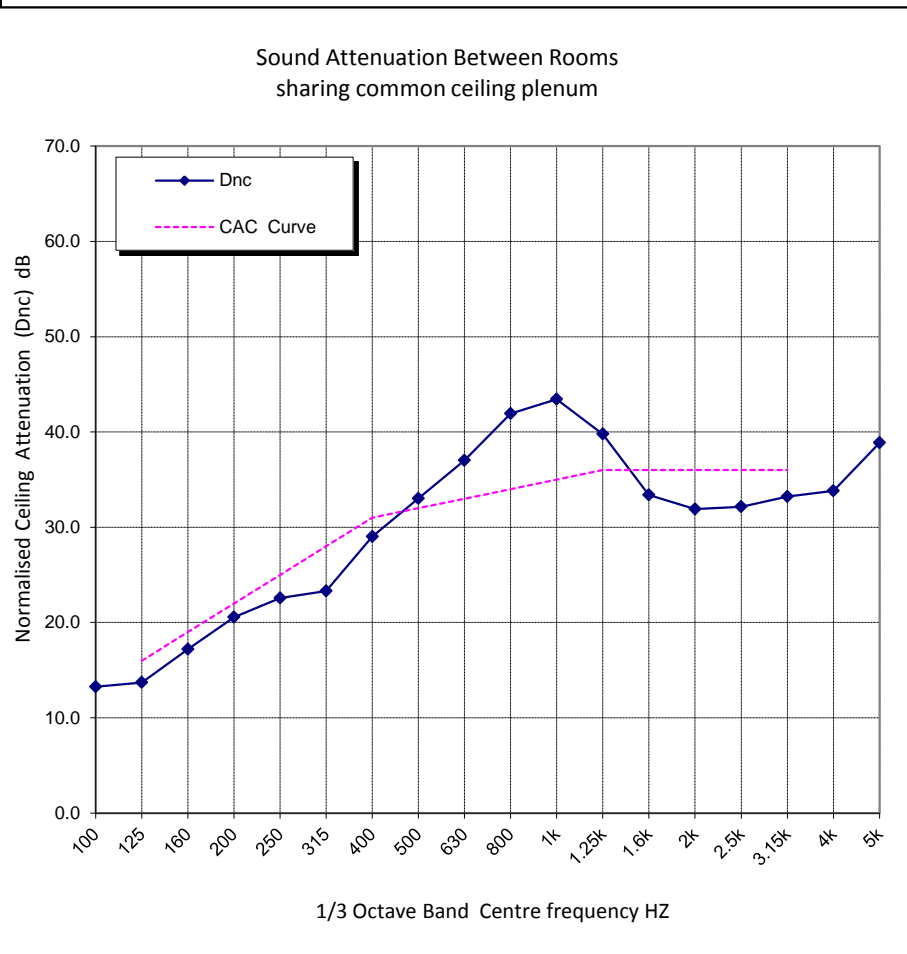

N Gabriels

Signatory:
Tester: N Gabriels B.Arch, FAAS

Date: 15-Apr-16

Kingsley Hearne

Checked: K Hearne B.Arch, MAAS